


Scoreboard with MPCW or MPCX2 Receiver

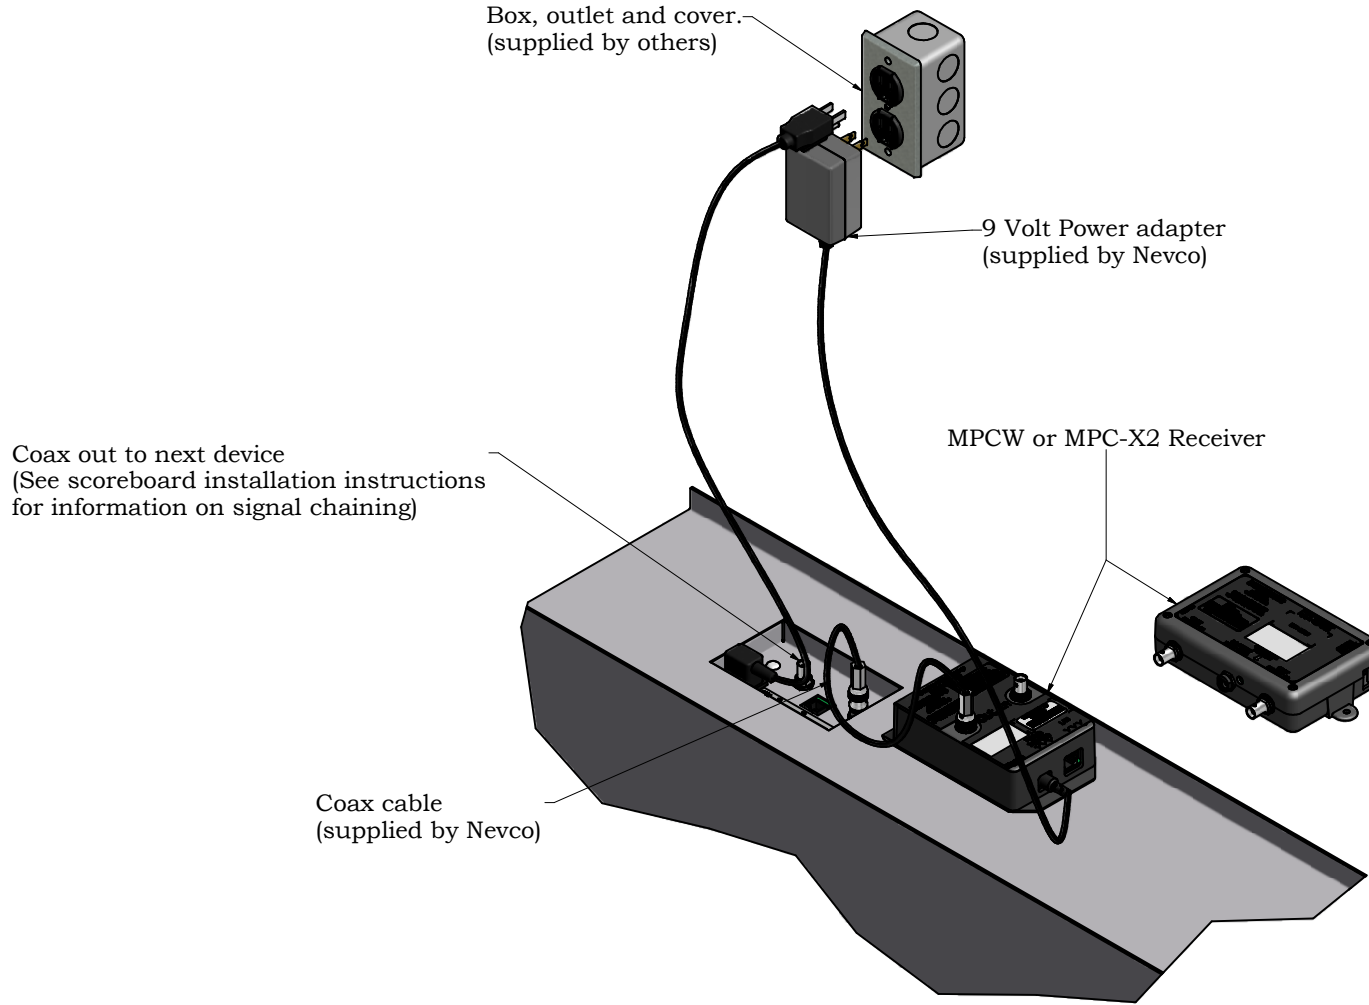

Note:
 -This scoreboard is intended to be installed in accordance with the requirements of Article 600 of the National Electrical Code and/or other applicable local codes. This includes proper grounding and bonding of the scoreboard.

-For power requirements see the scoreboard installation print for the model of scoreboard being installed

Indoor Installation
 Coax Connected
 MPCW or MPCX2
 Receiver
 (Top Mount)



Nevco, Inc.
 Greenville, Illinois 62246

Drawing No. 275-0134

Drawn MMK Date 4/29/15

Sheet 1 of 1